



# North Bihar Power Distribution Company Limited

Regd. Office-Vidyut Bhawan, Bailey Road, Patna.

CIN No:U40109BR2012SGC018920

(Department of Project II)

Letter No-288/

NB/P-II/Kishan/RDSS/ Vaishno Associates/70/2023

dated 18/7/23/

Contact No – 09264437179

Email – [cerdssnbpdc12@gmail.com](mailto:cerdssnbpdc12@gmail.com)

From,

Pranav Kumar  
Chief Engineer (Project-II)

To,

M/s Vaishno Associates Vidyut Projects LLP,  
H.O-14-15, 3<sup>rd</sup> Floor, Gajraj Tower,  
Motilal Atal Road, Jaipur-302001,

Email – [vaishno-elect@rediffmail.com](mailto:vaishno-elect@rediffmail.com), [rohitkr.elect@gmail.com](mailto:rohitkr.elect@gmail.com), [vaishno.rdsskishanganj@gmail.com](mailto:vaishno.rdsskishanganj@gmail.com)

Sub: - Regarding approval of GTP & Drawing of Stone Base Plate for work of RDSS Project against NIT No.-35/PR/NBPDCL/2022 for Kishanganj Circle.

Ref :- 1) NIT No.-35/PR/NBPDCL/2022  
2) NOA No.-23 & 24 dated 06.03.2023  
3) Your Lt. No.- VAVP/NBPDCL/RDSS/KISH/2023-24/68 dated 17-07.2023

Sir

With reference to the subject noted above, please find enclosed herewith the GTP & drawing for Stone Base Plate for Development of Distribution Infrastructure against NIT No.-35/PR/NBPDCL/2022 for Kishanganj Circle under Revamped Reforms-Based And Results-Linked, Distribution Sector scheme.

Sl. No.	Name of Firm and address	Name of Material/Equipment
1.	M/s SHRI RAM ENTERPRISES Registered office at – 8/23, JAWAHARGANJ, DABRA, GWALIOR, M.P (475110 )	STONE BASE PLATE


The Correction wherever required in GTP/Drawing submitted by the manufacturer has been done. However, these drawing shall be subject to correctness as per technical specifications of the tender document and the entire responsibility of the correctness of the drawing as per the specification as well as supply of material according to the technical specification of the contract agreement shall be responsibility of the contractor.

In case of any conflict or contradiction between GTP/ Drawings & Technical Specification, the decision of C.E. (Project-II) shall be final and binding on both the parties. Contractor shall have to replace the material to the entire satisfaction of the owner in case the material is found unsuitable for use in the project, at any stage.

Please carry out the works immediately under conditions stated above.

Encl:- As above.

Your faithfully

  
(Pranav Kumar) 18/7/2023

Chief Engineer (Project-II)

Memo no 288/

dated 18/12/23/

Copy forwarded M/s Vindhya Telelinks Limited, Club 125, 6<sup>th</sup> Floor, Tower A, Plot No- 3, 4 & 5, Sector 125, Noida, UP-201301/ M/s Ashoka Buildcon Ltd., S.No.-861, Ashoka House, Ashoka Marg, Vadala, Nashik-422011/M/s Polycab India Ltd., Polycab House, 771, Pandit Satwalekar Marg, Mumbai / M/s NCC Ltd., NCC House, Survey no. 64, Madhapur, Hyderabad, 500081 / M/s JSP Projects Pvt. Ltd., Flat No.-5, IInd Floor, IIIrd B-2, Nehru Nagar, Ghaziabad (UP)-201001 /M/s CABCON India Ltd., 1<sup>st</sup> Floor, The Terminus Building, RG-12, Action Area- 1 B, New Town, Kolkata-700156 / M/s Techno Power Enterprises Pvt., INFINITY "THINK TANK" Tower II, 10<sup>th</sup> Floor Plot No. A3, Block-GP, Sector V, Salt Lake City, Kolkata-700091 (WB) for information and necessary action.

*Pranav Kumar*  
18/12/2023

(Pranav Kumar)

Chief Engineer (Project-II)

dated 18/12/23/

Memo no 288/

Copy forwarded to Chief Engineer, Project-I (Urban), NBPDCCL for information and further needful action.

*Pranav Kumar*  
18/12/2023

(Pranav Kumar)

Chief Engineer (Project-II)

dated 18/12/23/

Memo no 288/

Copy forwarded to M/s Rodic Consultant, Hq team for information and further needful.

*Pranav Kumar*  
18/12/2023

(Pranav Kumar)

Chief Engineer (Project-II)

dated 18/12/23/


Memo no 288/

Copy forwarded to OSD to MD/ Director (Project), NBPDCCL for kind information.

*Pranav Kumar*  
18/12/2023

(Pranav Kumar)

Chief Engineer (Project-II)

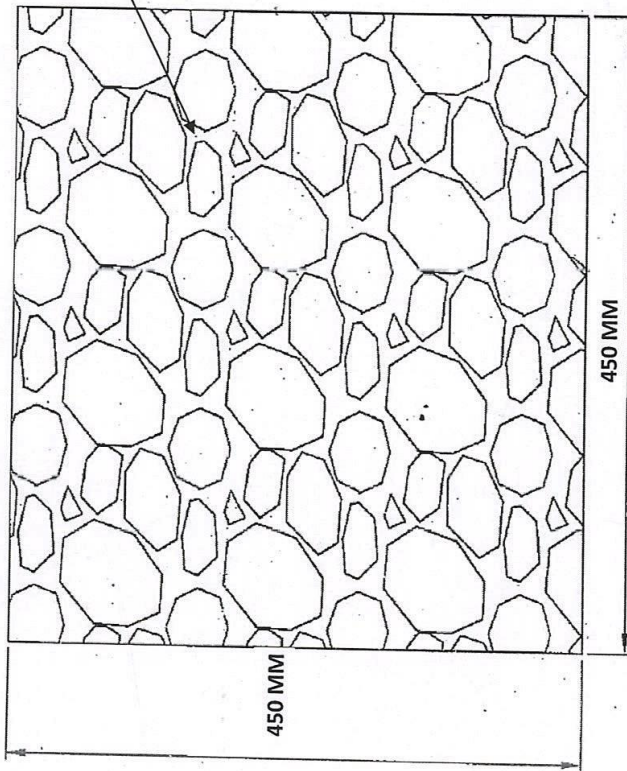


Rough Surface

Notes :-

- 1) All Dimensions are in MM.
- 2) Hard Rough Stone for Base Plate.
- 3) Thickness of Base Plate is 50 MM.
- 4) General Tolerance -  $\pm 10\%$  **5%**

Owner	M/s. North Bihar Power Distribution Company Limited
Project	RDSS Work At Kishanganj Electric-Supply Circle
Contractor	M/s. Vaishno Associates Vidyut Project LLP, Jaipur
LOA No.	NB/P-II/RDSS/Tender/25/2022 NOA No.23& 24 Dated -06.03.2023
Title	Stone Pad of Size 450x450x50 MM
Drawing No.	SRE / Stone 450-50 / 2015
SHREE RAM ENTERPRISES 8/23, JawaharGan, Dabra - 475 110 (M.P.)	




**CHECKED**

M. J. AEE(P-II) EEE(P-II) ESE(P-II)

**APPROVED**  
Subject to the condition that you are not absolve of the responsibility of correctness of materials

*(Signature)*  
Chief Engineer (Project-II)  
NBPDC

175

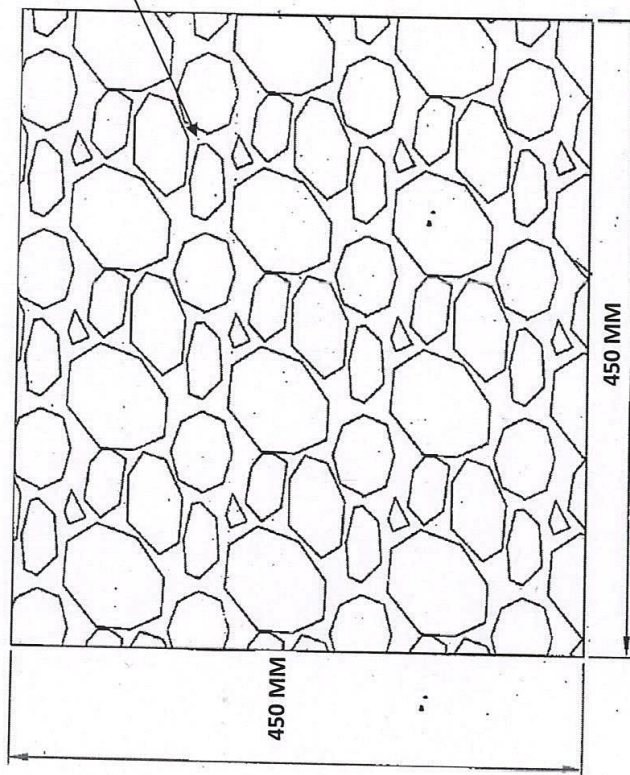

Notes :-

- 1) All Dimensions are in MM.
- 2) Hard Rough Stone for Base Plate.
- 3) Thickness of Base Plate is 50 MM.
- 4) General Tolerance - ± 10%

Owner	M/s. North Bihar Power Distribution Company Limited
Project	RDSS Work At Kisanganj Electric Supply Circle
Contractor	M/s. Vaishno Associates Vidyut Project LLP, Jaipur
LOA No.	NB/P-II/RDSS/Tender//25/2022 NOA No.23& 24 Dated -06.03.2023
Title	Stone Pad of Size 450x450x50 MM
Drawing No.	SRE / Stone 450-50 / 2015
SHREE RAM ENTERPRISES	
8/23, JawaharGanj, Dabra - 475 110 (M.P.)	



CHECKED

M 9/4  
AEE(P-II) EEE(P-II) ESE(P-II)

**APPROVED**  
Subject to the condition that you are not absolving the responsibility of the correctness of material's

*[Signature]*  
Chief Engineer (Project)  
NBPD

174